

COLORADO DIVISION OF WATER RESOURCES

1313 Sherman Street - Room 818
Denver, Colorado 80203

COPY

THIS FORM MUST BE SUBMITTED
WITHIN 60 DAYS OF COMPLETION
OF THE WORK DESCRIBED HERE-
ON. TYPE OR PRINT IN BLACK
INK.

WELL COMPLETION AND PUMP INSTALLATION REPORT

PERMIT NUMBER R 557 - RF

Case # 707

WELL OWNER M. J. Ensor Jr., Edna Ensor Mary Edith Wilkins & J.R. Williams MW % of the SW % of Sec. 8

ADDRESS 7951 S. Santa Fe Drive, Littleton, CO T. 1 N. R. 66 W. 6th P.M.

80120

DATE COMPLETED 11/12, 1980

HOLE DIAMETER

72 in. from 0 to 56 ft.

_____ in. from _____ to _____ ft.

_____ in. from _____ to _____ ft.

DRILLING METHOD Orange Peel

CASING RECORD: Plain Casing

Size 4 & kind Concrete from 0 to 30 ft.

Size _____ & kind _____ from _____ to _____ ft.

Size _____ & kind _____ from _____ to _____ ft.

Perforated Casing

Size 4 & kind Concrete from 30 to 57 ft.

Size _____ & kind _____ from _____ to _____ ft.

Size _____ & kind _____ from _____ to _____ ft.

GROUTING RECORD

Material Concrete

Intervals 0 - 57

Placement Method Placed

GRAVEL PACK: Size 3/4

Interval 30 - 57

TEST DATA

Date Tested 11/12, 19 80

Static Water Level Prior to Test 20 ft.

Type of Test Pump Turbine

Length of Test 6

Sustained Yield (Metered) 400

Final Pumping Water Level 48' 1"


WELL LOG

From	To	Type and Color of Material	Water Loc.
0	3	Top Soil	
3	6	Sand	
6	28	Fine Gravel	
28	30	Clay, brown	
30	35	Sand, fine	
35	38	Fine gravel	
38	41	Clay, brown	
41	46	Clay, Sand mix	
46	49	Clay, brown, hard	
49	56	Gravel, med. clean	
	56	Shale	
		TOTAL DEPTH <u>56</u>	

Use additional pages necessary to complete log.

PUMP INSTALLATION REPORT

Pump Make: Western Land Roller
 Type: Turbine
 Powered by: 110 HP 40
 Pump Serial No.: 10 PM 5 etc.
 Motor Serial No.: _____
 Date Installed: 1-5-81
 Pump Intake Depth: 85' 6"
 Remarks: _____

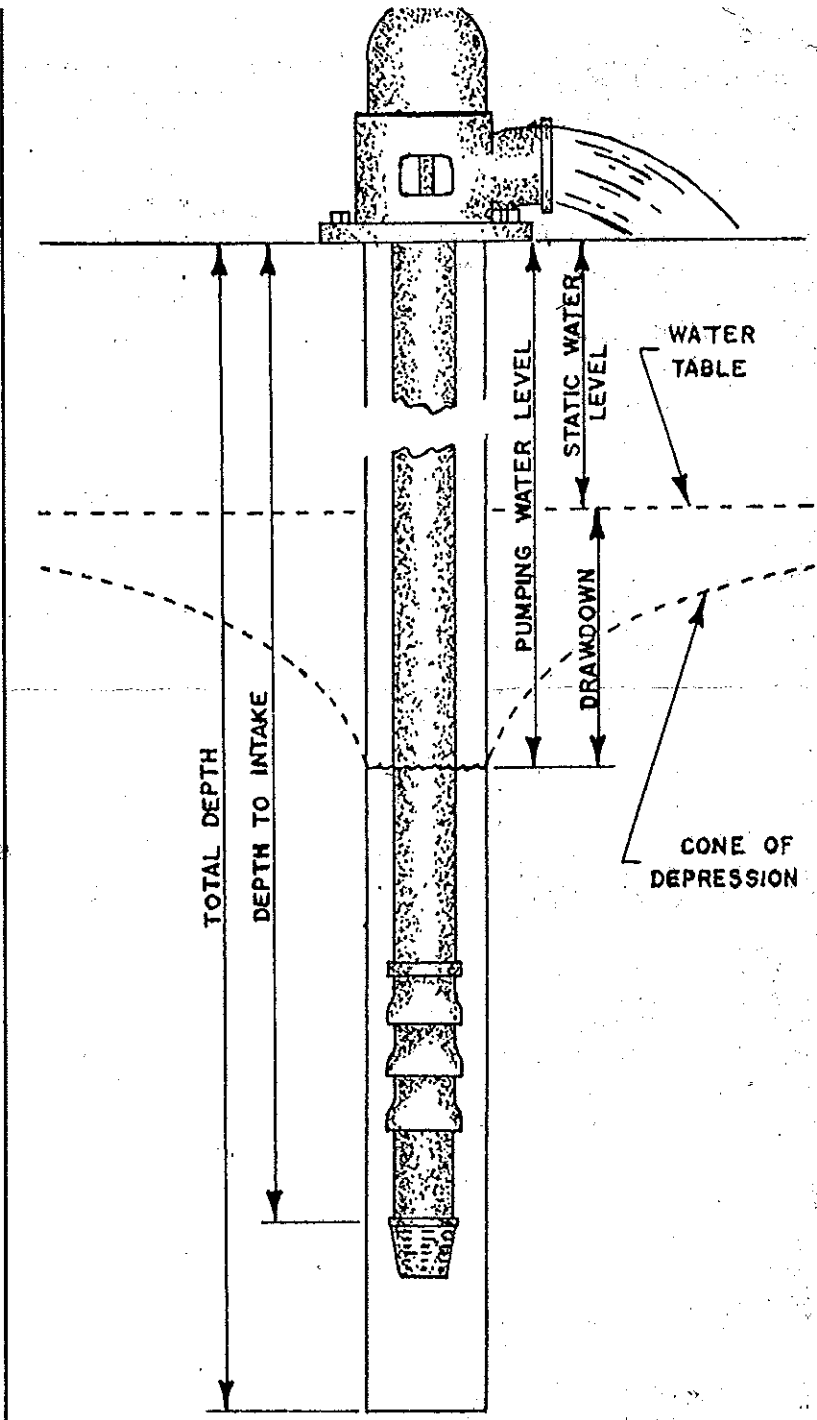

WELL TEST DATA WITH PERMANENT PUMP

Date Tested: No power available at this time
 Static Water Level Prior to Test: _____
 Length of Test: _____ Hours
 Sustained yield (Metered): _____ GPM
 Pumping Water Level: _____
 Remarks: Pump designed 400 GPM

CONTRACTORS STATEMENT

The undersigned, being duly sworn upon oath, deposes and says that he is the contractor of the well or pump installation described hereon; that he has read the statement made hereon; knows the content thereof, and that the same is true of his own knowledge.

Signature: Harry E. Smith License No. 446 1071

State of Colorado, County of Adams SS

Subscribed and sworn to before me this 5 day of January, 19 81.

My Commission expires: 25 Sept, 19 83.

Notary Public: Roger Nildow

FORM TO BE MADE OUT IN QUADRUPPLICATE: WHITE FORM must be an original copy on both sides and signed. WHITE AND GREEN copies must be filed with the State Engineer. PINK COPY is for the Owner and YELLOW COPY is for the Driller.